


## 2008-09-11 Pbar Department Meeting

Thursday, September 11, 2008  
10:00 AM

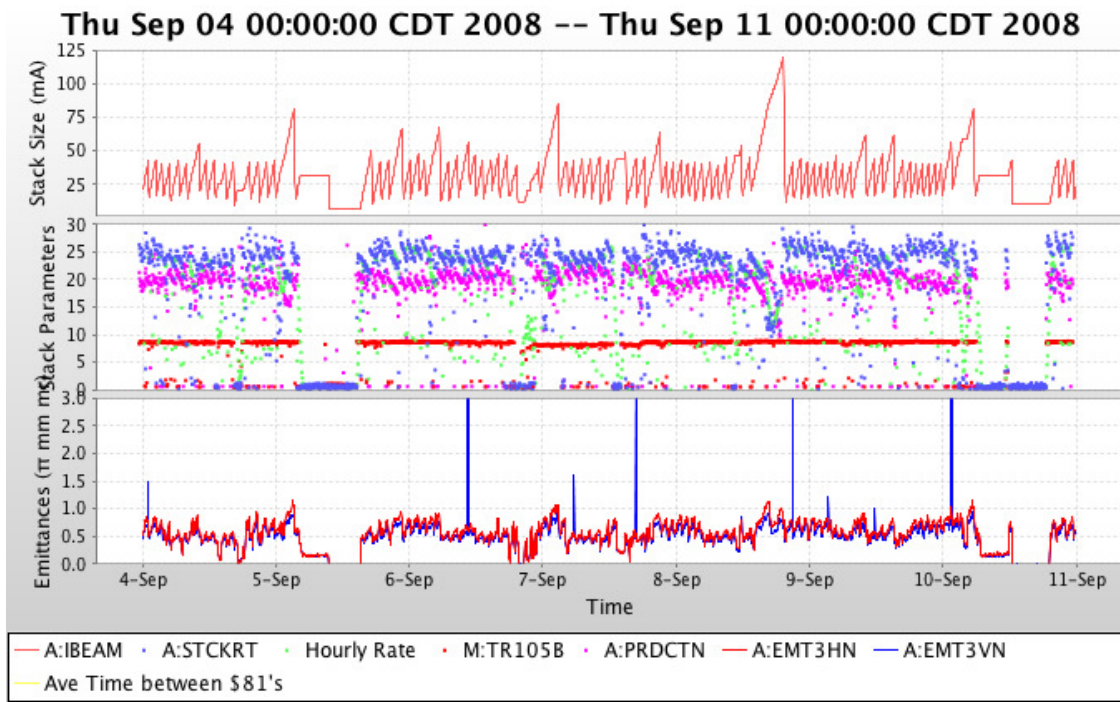

Pasted from <<http://www-bdnew.fnal.gov/pbar/organizationalchart/derwent/stacking/weekly.png>>

- Stacking this week
  - Last Friday, Lens power supply again. Same thing that happened previous Wednesday.
- Delta Kicker Study
  - <http://www-bd.fnal.gov/cgi-mach/machlog.pl?nb=pbar08&action=view&page=399&scroll=false&load=>
  - Resonance that we tried to compensate years ago, we couldn't see yesterday.
- A:IKIK
  - Monday went to 44KV
  - Tuesday went to 46KV, and saw some vac activity.
  - Wed. Back to 46KV
  - Thursday - tried 48KV, lots of vacuum activity.
  - Back down to 44KV, and try 46KV again.
- Shutdown jobs
  - A:IKIK bakeout vs Voltage Measurements
  - CUB wants to turn off 8 hours for one day.
  - Remove collimators
  - Rad safety needs to go through and figure out if they can handle all the jobs...